


NOTE:
 PER NFPA 820, ALL CLASS I, GROUP D, DIV 2 ITEMS ARE SHOWN INSIDE OF RED HIGHLIGHTED AREA.
 THIS INCLUDES THE INTERIOR OF THE TANK FROM THE MINIMUM OPERATING WATER SURFACE TO
 THE TOP OF THE TANK WALL, 18" ABOVE THE TOP OF THE TANK AND EXTENDING 18" BEYOND
 EXTERIOR WALL AND 18" ABOVE GRADE EXTENDING 10' HORIZONTALLY FROM THE EXTERIOR
 TANK WALLS.




D <small>©COPYRIGHT 2010 GUY ALL RIGHTS RESERVED - REV E</small>		 THIRD ANGLE PROJECTION		 Bringing water to life	
<small>THIS DRAWING CONTAINS CONFIDENTIAL PROPRIETARY INFORMATION OF OVIVO, AND ITS AFFILIATES, AND IS NOT TO BE DISCLOSED NOR TO BE USED EXCEPT FOR EVALUATING PROPOSALS OF OVIVO OR INSTALLING, OPERATING OR MAINTAINING OVIVO EQUIPMENT UNLESS OTHERWISE AUTHORIZED IN WRITING BY OVIVO. UNCONTROLLED COPY IF PRINTED</small>				NFPA 820 CLASSIFICATION	
REF. FROM		DO NOT SCALE PRINTS			
DATE (mm/dd/yy)	1/21/2015	WORKMANSHIP STANDARD W5-7501-01 APPLIES			
DRAWN	GDG	ORIGINAL S.O.		DWG. NO.	011615-1-NFPA
CHECK'D				SHEET	1 OF 2
INITIAL RELEASE				REV	A
REVISION DESCRIPTION	EN/ECO	BY	CHECK'D	DATE	REV

INITIAL RELEASE					A
REVISION DESCRIPTION	EN/ECO	BY	CHECK'D	DATE	REV

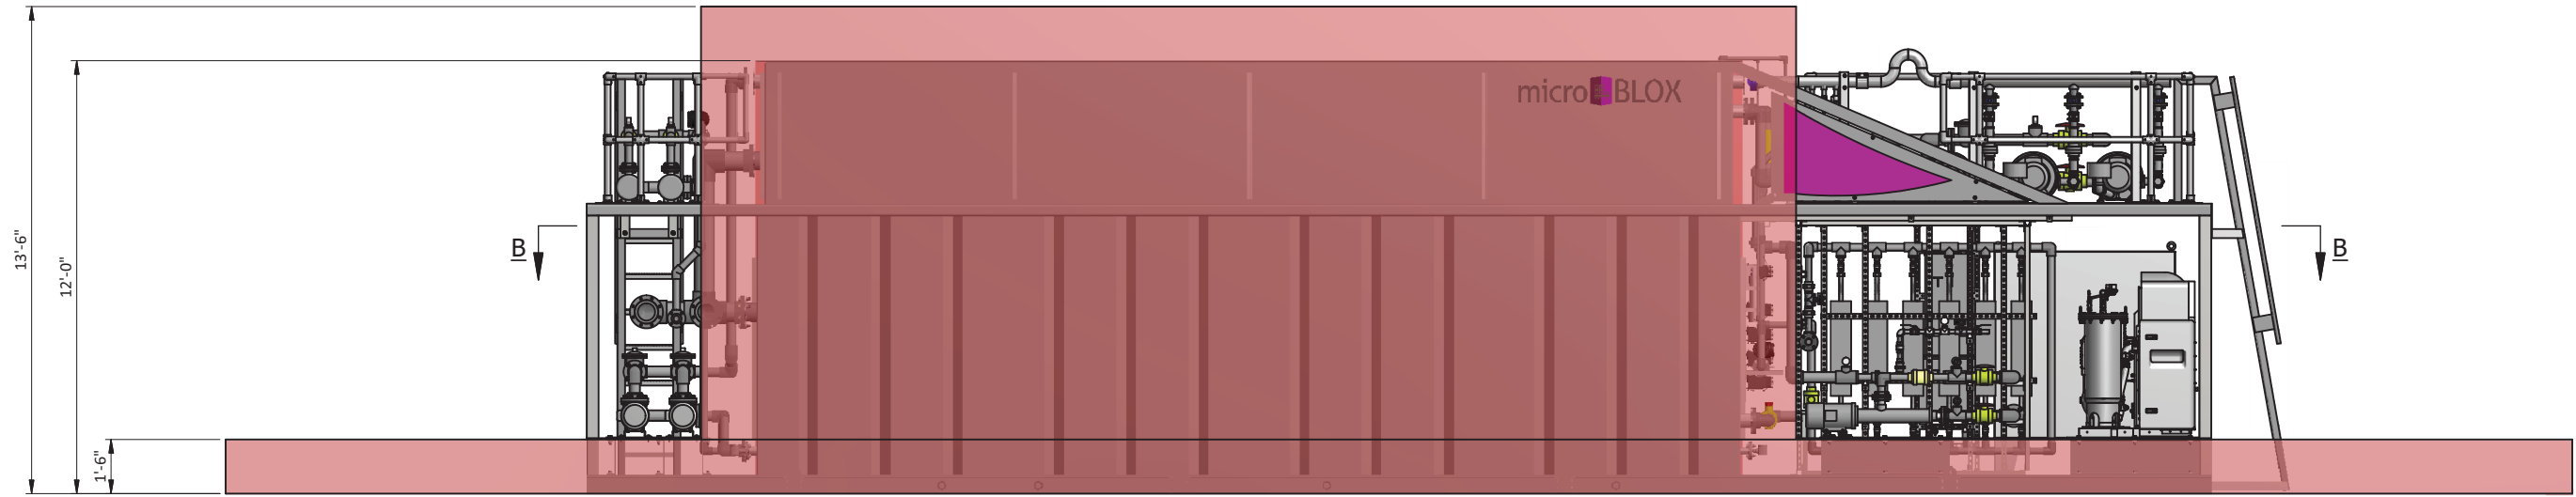

VIEW A-A

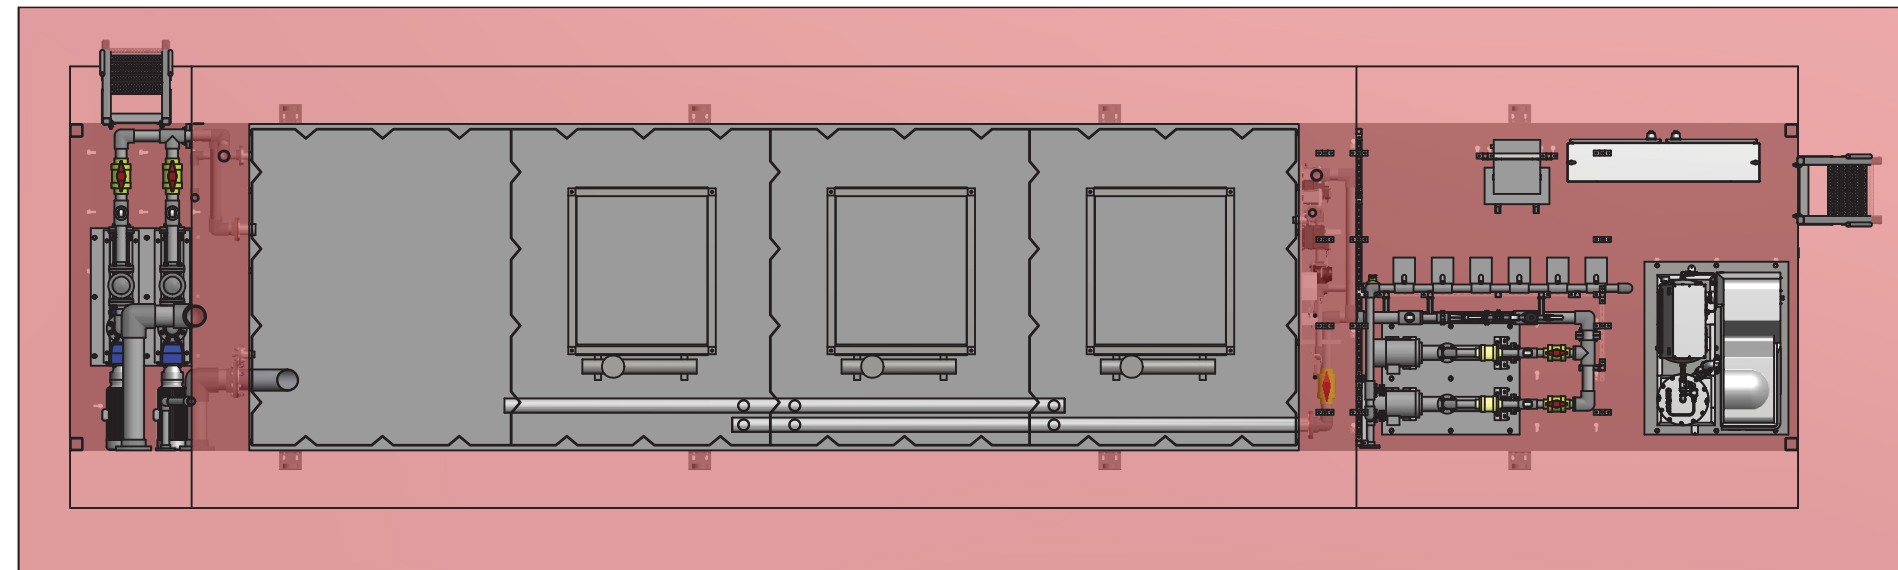

SECTION B-B